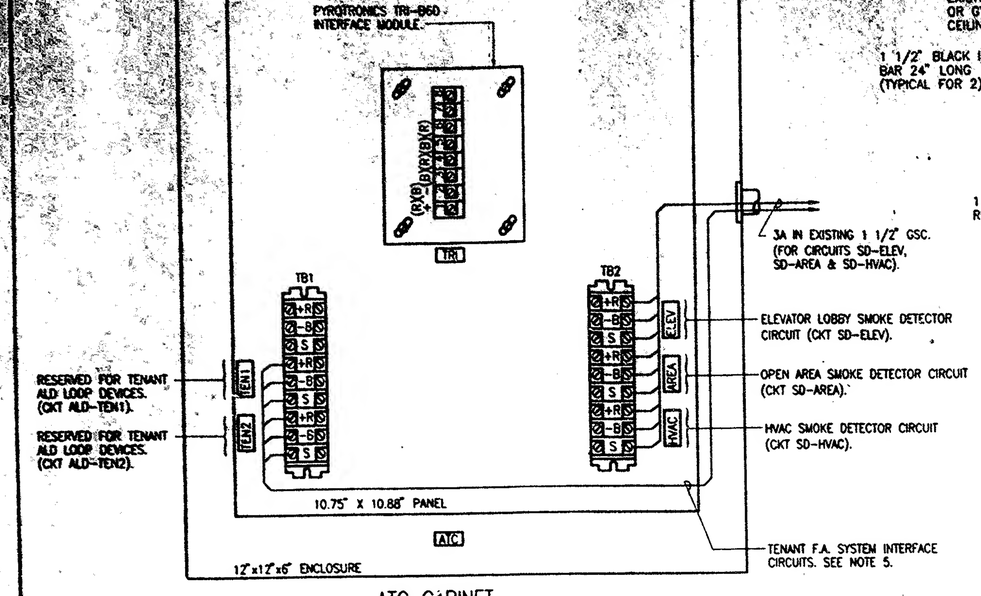

ATC CABINET
BLOCK WIRING DIAGRAM
N.T.S.

NOTES: EXISTING WIRING NOT SHOWN.

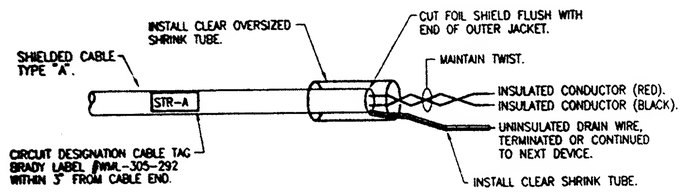

TYPICAL SHIELD/DRAIN INSULATING METHOD "A"
N.T.S.

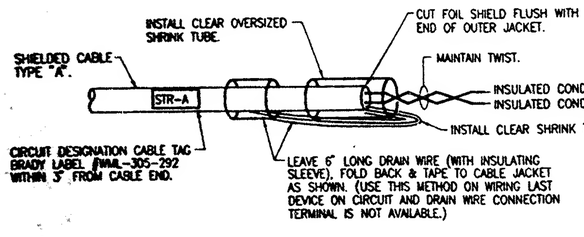

TYPICAL SHIELD/DRAIN INSULATING METHOD "B"
N.T.S.

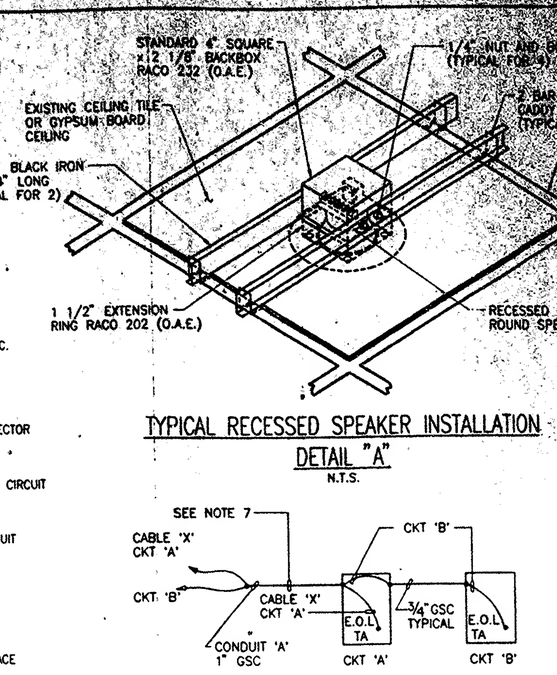

TYPICAL RECESSED SPEAKER INSTALLATION
DETAIL "A"
N.T.S.

TOWER "B" 44TH FLOOR
TENANT AMPLIFIER WIRING DIAGRAM DETAIL
N.T.S.

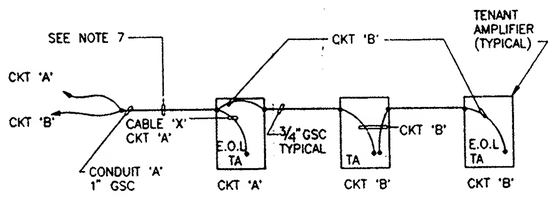

TOWER "A" 44TH FLOOR
TENANT AMPLIFIER WIRING DIAGRAM DETAIL
N.T.S.

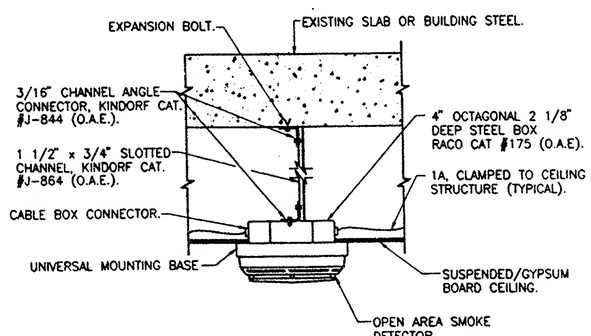

SMOKE DETECTOR INSTALLATION DETAIL "C"
(FOR SUSPENDED CEILING)
N.T.S.

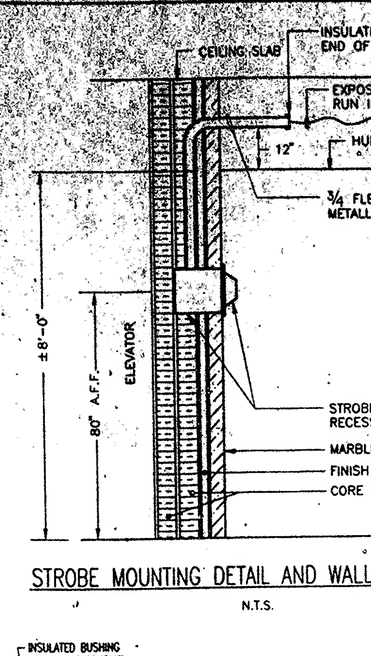

STROBE MOUNTING DETAIL AND WALL
N.T.S.

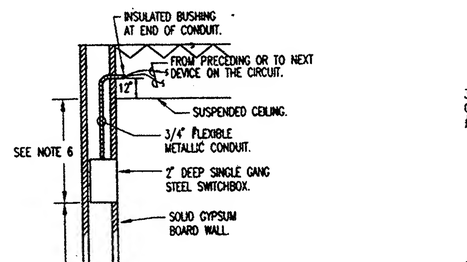

TYPICAL FLUSH MOUNTED
STROBE, SPEAKER OR COMBINATION
INSTALLATION DETAIL "B"
N.T.S.

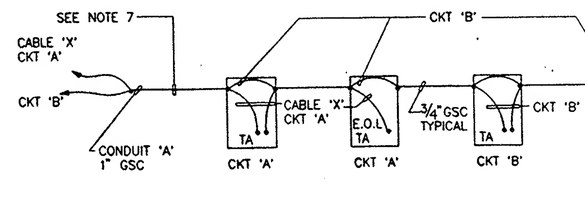

TOWER "A" AND "B" 78TH FLOOR
TENANT AMPLIFIER WIRING DIAGRAM D
N.T.S.

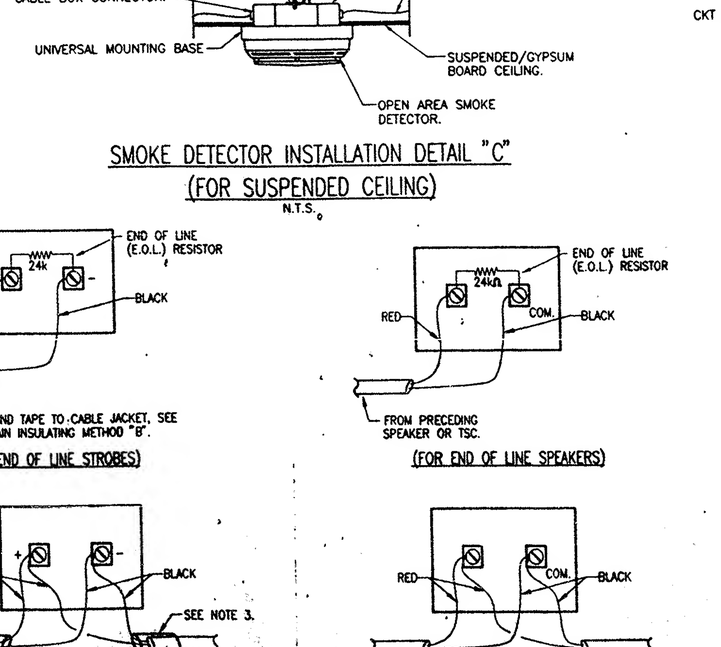

TYPICAL SMOKE DETECTOR WIRING DIAGRAM

TYPICAL STROBE WIRING DIAGRAM

TYPICAL SPEAKER WIRING DIAGRAM

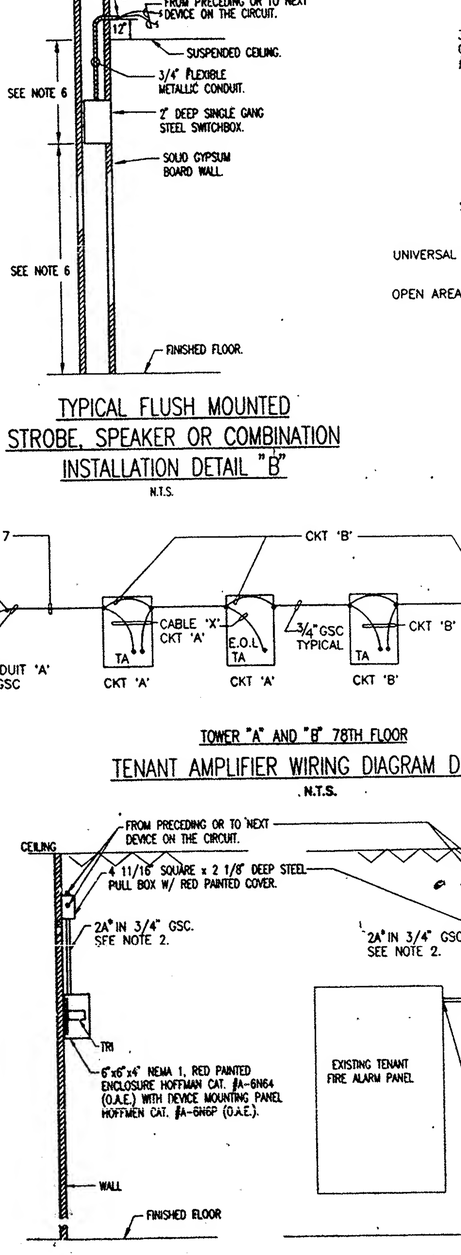

TYPICAL SURFACE MOUNTED TRI INSTALLATION
(NEAR EXISTING SURFACE MOUNTED TENANT F
N.T.S.